SCALE: NO SCALE
DATE: JAN. 1985

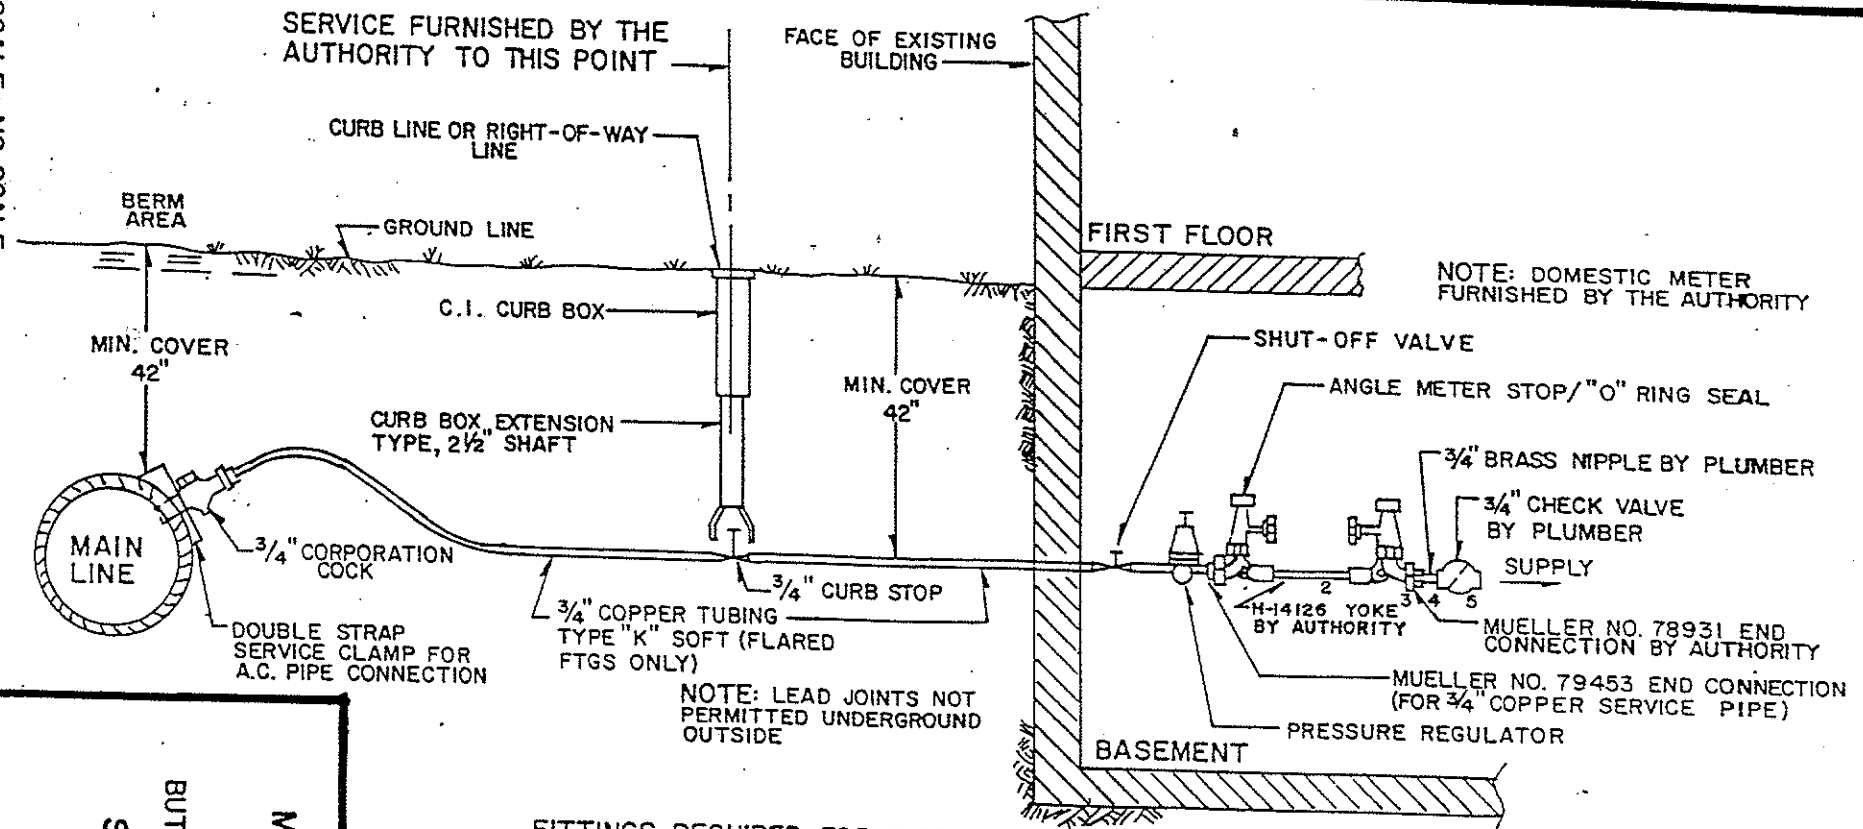

FITTINGS REQUIRED FOR INSTALLATION OF WATER METER

1.) ¾" FLARED ~~MALE~~ Female ADAPTOR, BRASS, MUELLER NO. 79453 (FURNISHED BY AUTHORITY)
2.) METER YOKE WITH PLAIN STOP, MUELLER NO. H-14062 (F.B.A.)
3.) ¾" COMBINATION TAILPIECE WITH I.P. THREAD (MUELLER NO. 78931 (F.B.A.)
4.) ¾" BRASS NIPPLE
5.) ¾" CHECK VALVE, BRASS, I IRON PIPE THREADS, MINIMUM SIZE

note: Shut-off valve furnished by the owner
pressure regulator furnished by the owner

If service line is over 150 feet, please call the office for further instructions. 295-2703

MUNICIPAL AUTHORITY
BUFFALO TOWNSHIP
BUTLER COUNTY, PENNSYLVANIA
SERVICE CONNECTION
DETAIL